
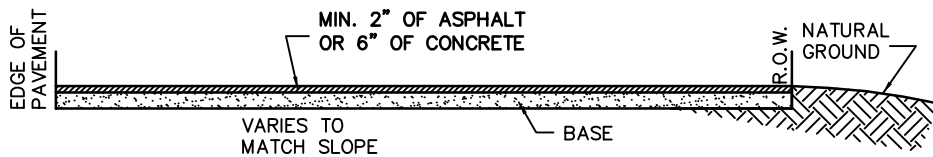


# HAYS COUNTY DRIVEWAY STANDARD

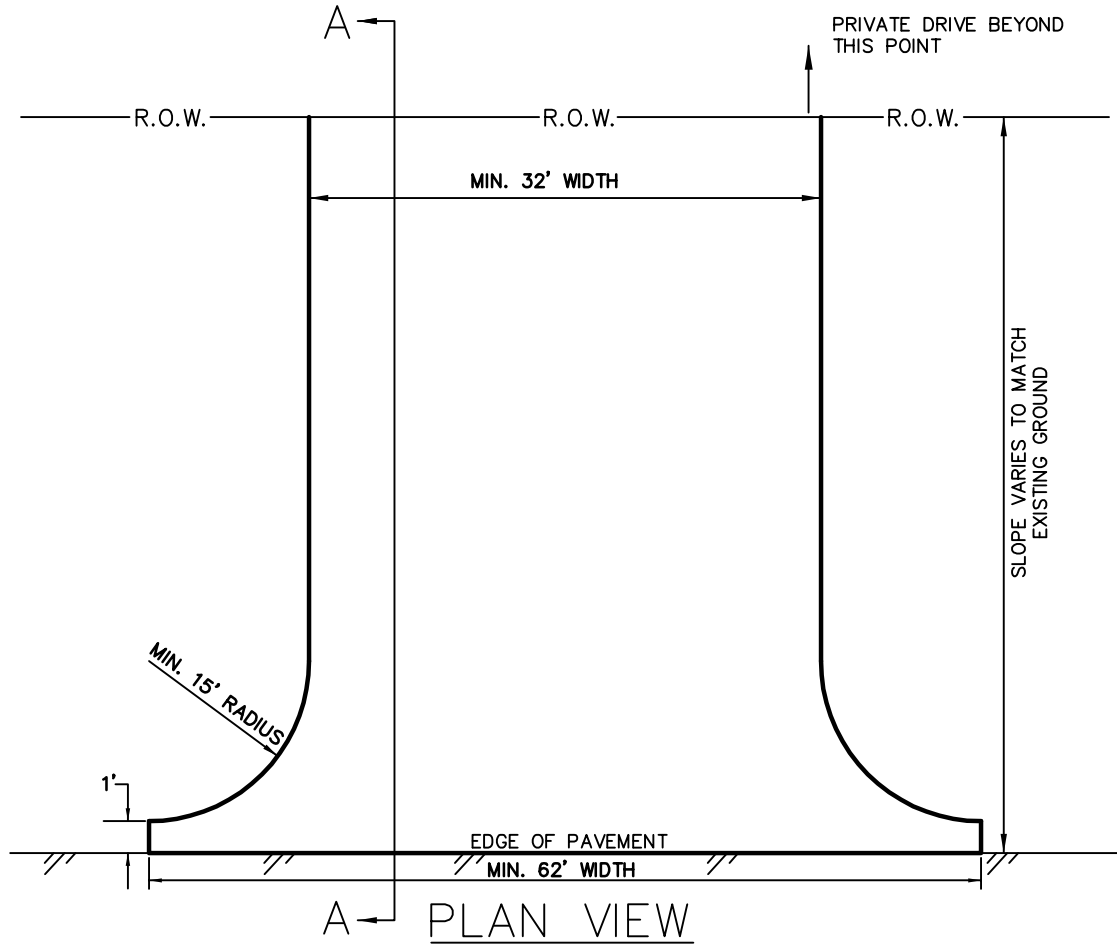

SECTION A-A

NOT TO SCALE

**NOTES:**

- Engineered drawings shall be submitted with commercial driveway permit applications.
- Driveway shall be constructed of either 6" of class "A" concrete reinforced with #3 bars at 18" OC both ways over 2" of compacted base or 2" of asphalt over 8" of compacted base.
- The slope of the driveway shall match the slope of existing ground.
- An expansion joint shall be placed at the ROW line, with #4 smooth bars placed at mid depth 12" OC.

HAYS COUNTY, TEXAS  
COMMERCIAL DRIVEWAY  
SHEET FLOW