
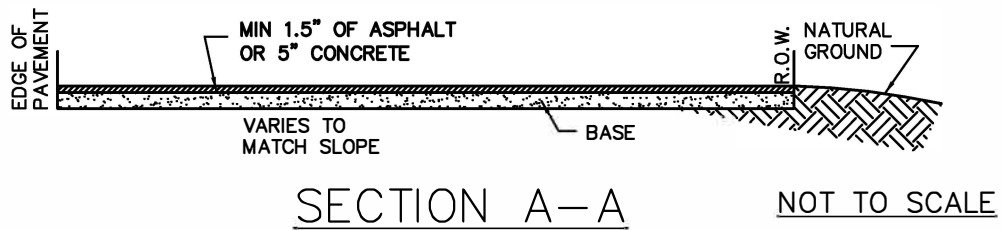


# HAYS COUNTY DRIVEWAY STANDARD

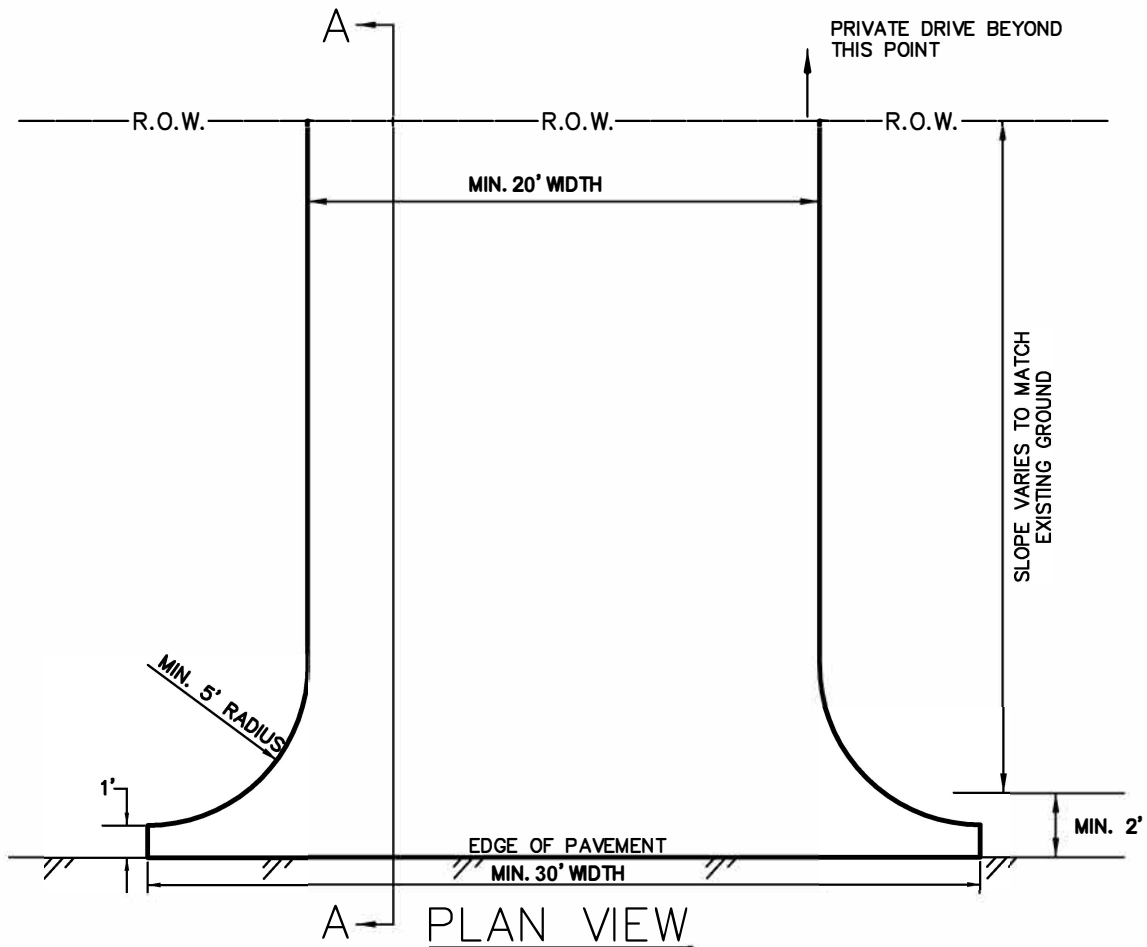

## NOTES:

- Driveways shall be constructed of either 5" of class "A" concrete reinforced with 6ga welded wire mesh over 2" of compacted base or 1.5" of asphalt over 6" of compacted base.
- The slope of the driveway shall match the slope of the existing ground.
- An expansion joint shall be placed at the ROW line, with #4 smooth bars placed at mid depth 12" OC.

HAYS COUNTY, TEXAS  
RESIDENTIAL DRIVEWAY  
SHEET FLOW