
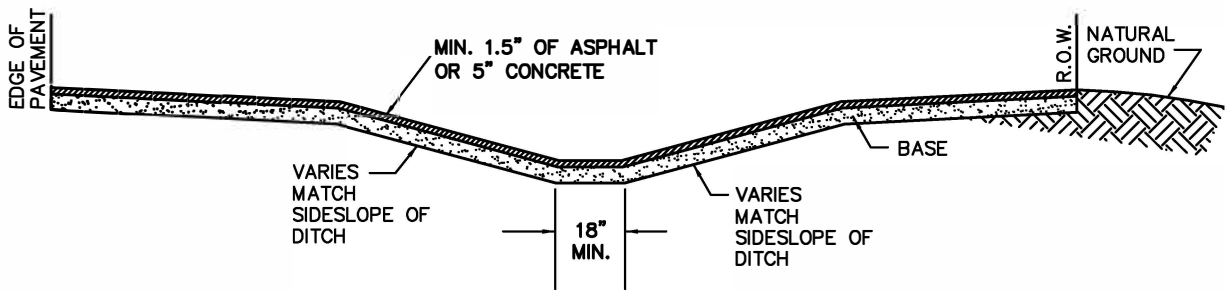


HAYS COUNTY DRIVEWAY STANDARD

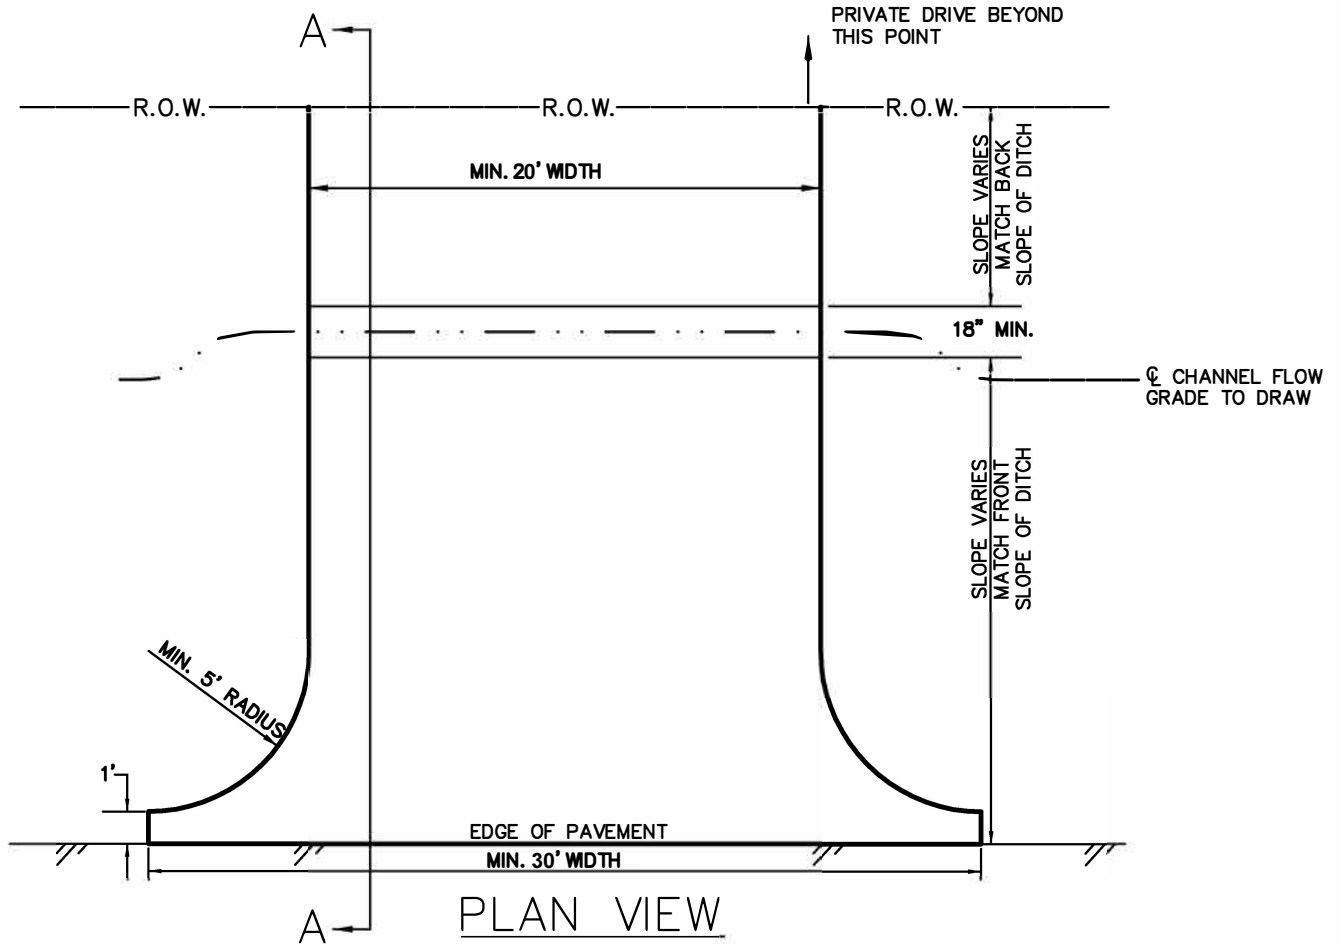

SECTION A-A

NOT TO SCALE

NOTES:

- Driveways shall be constructed of either 5" of class "A" concrete reinforced with 6ga welded wire mesh over 2" of compacted base or 1.5" of asphalt over 6" of compacted base.
- The top of the dip section shall match the flowline of the ditch.
- An expansion joint shall be placed at the ROW line, with #4 smooth bars placed at mid depth 12" OC.

HAYS COUNTY, TEXAS
RESIDENTIAL DRIVEWAY
DIP-STYLE